


MOUNTING INSTRUCTIONS

TURN THE DAMPER FULLY CLOCKWISE.
DEPRESS CLUTCH AND TURN ACTUATOR FULLY CLOCKWISE.
PLACE UNIT OVER DAMPER SHAFT AND SECURE U-BOLT.
INSERT ANTI-ROTATION SCREW LEAVING SOME PLAY IN THE UNIT.
DEPRESS THE CLUTCH AND CHECK ENTIRE ASSEMBLY
FOR SMOOTH OPERATION.
ADJUST END OF SHOCK STOPS IF NECESSARY.

NOTE
CONTROLLER MUST BE MOUNTED IN
AN UPRIGHT POSITION AS SHOWN.
IF ACTUATOR MUST BE MOUNTED IN
OTHER THAN UPRIGHT POSITION
LEAVE A LOOP IN THE FLOW SENSOR
TUBING SO THAT CONDENSATION
WILL NOT RUN INTO THE CONTROLLER.

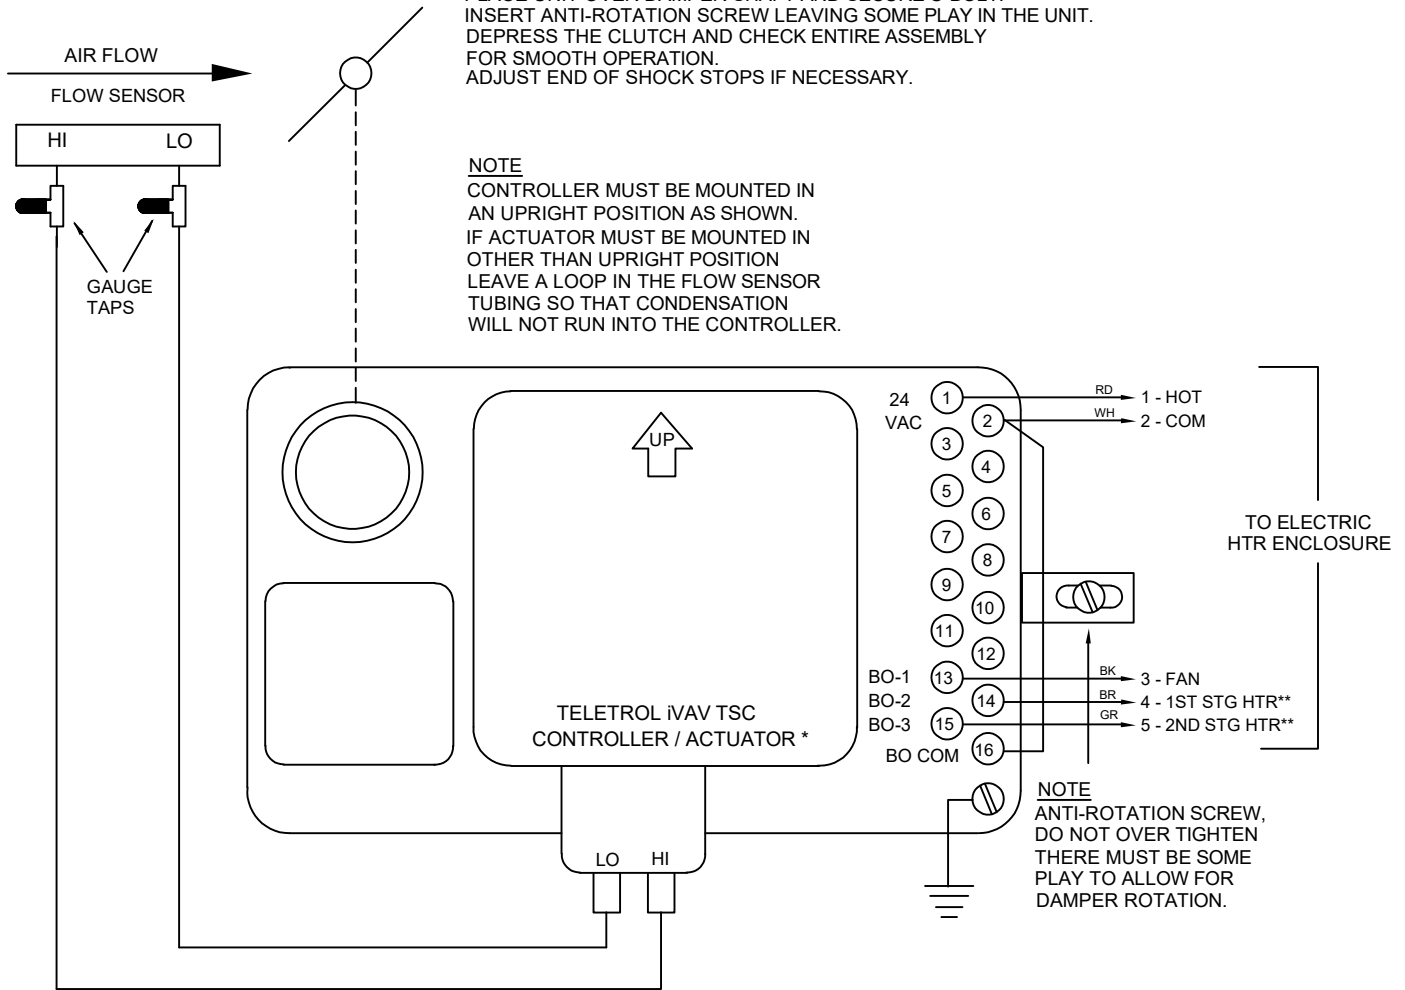

NOTE :

* INDICATES COMPONENTS SUPPLIED BY CONTROL CONTRACTOR.
** WIRE HEATER STAGE AS REQUIRED

LEGEND

————— FACTORY FLOW SENSOR TUBING
————— FACTORY ELECTRICAL WIRING

PROJECT:



ENGINEER:

CUSTOMER:

16330

SUBMITTAL DATE:

SPEC. SYMBOL:

04/03/2010

**FAN POWERED
TELETROL iVAV-TSC**
Clg., HW REHEAT
OR UP TO 2 STG ELEC REHEAT
Variable & Constant Volume