


INSTALLATION NOTE :

THE NEW ZN341A CONTROLLER / ACTUATOR PACKAGE WILL NOT FIT INSIDE OUR STANDARD DDC ENCLOSURE. PRICE INDUSTRIES WILL SEPARATE THE ACTUATOR FROM THE ZN341A CONTROLLER SO THAT BOTH ITEMS CAN BE MOUNTED INSIDE THE STANDARD ENCLOSURE.

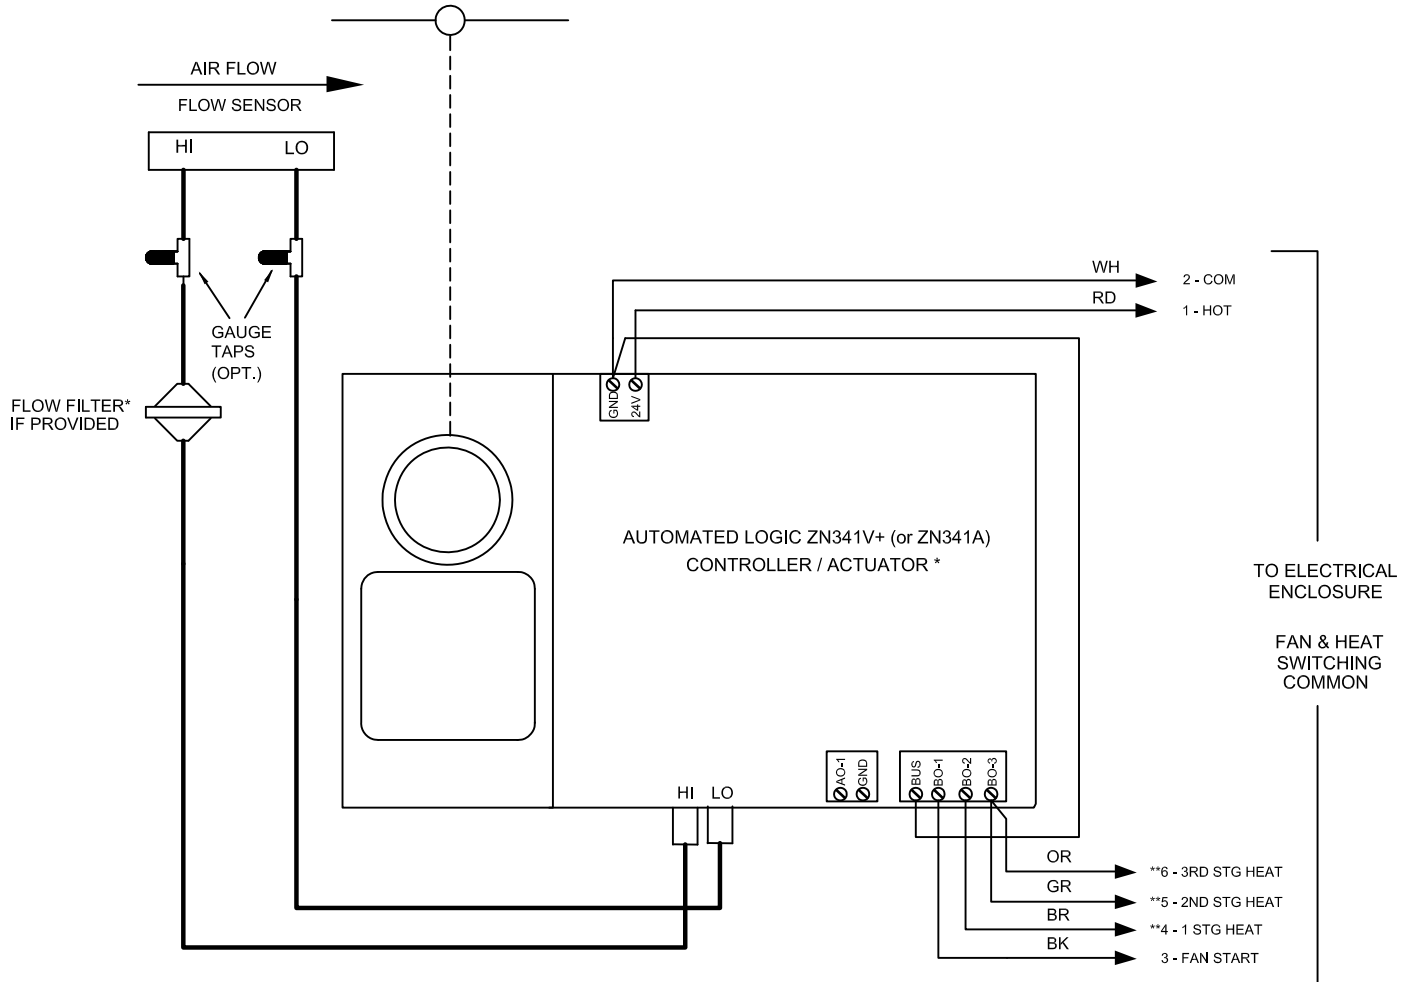

NOTE :

\* INDICATES COMPONENTS SUPPLIED BY CONTROL CONTRACTOR.  
\*\* WIRE HEATING STAGE AS REQUIRED PER ORDER LINE

**LEGEND**

— FACTORY FLOW SENSOR TUBING  
— FACTORY ELECTRICAL WIRING

**PROJECT:**

**ENGINEER:**

**CUSTOMER:**

**SUBMITTAL DATE:**

**SPEC. SYMBOL:**



W16303

2018/06/05

**FAN POWERED  
ALC ZN341VA**  
COOLING,  
OPT. HW REHEAT or  
UP TO 3 STG. ELE. REHEAT  
VARIABLE/CONSTANT VOLUME