

# FFUCS

## FAN FILTER UNIT CONTROL SYSTEMS

### FEATURES:

- WALL MOUNTED SPEED CONTROLLER: OFFERS SIMPLE USER CONTROL FOR UP TO 30 FAN FILTER UNITS WITH THE SAME SETPOINT.
- BACnet FLOW CONTROLLER SERVICE TOOL: PROVIDES ACCESS TO BACnet FLOW CONTROLLER (BFC) MENUS AND CONTROLS ON A REMOTE DEVICE FOR EASE OF ACCESS IN LOW CLEARANCE INSTALLATIONS.
- WEB SERVER: PROVIDES FULL CONTROL AND MONITORING OF FAN FILTER UNITS ON A GRAPHICAL WEB-BASED INTERFACE AND COMMUNICATES WITH A VARIETY OF BUILDING CONTROL SYSTEMS USING BACnet COMMUNICATION PROTOCOL.



**PRICE** | **CRITICAL ENVIRONMENTS**

PROJECT:


273558

Revision: 0

08-09-2021

# FFUCS

## FAN FILTER UNIT CONTROL SYSTEMS WALL MOUNTED SPEED CONTROLLER (WMSC-30)

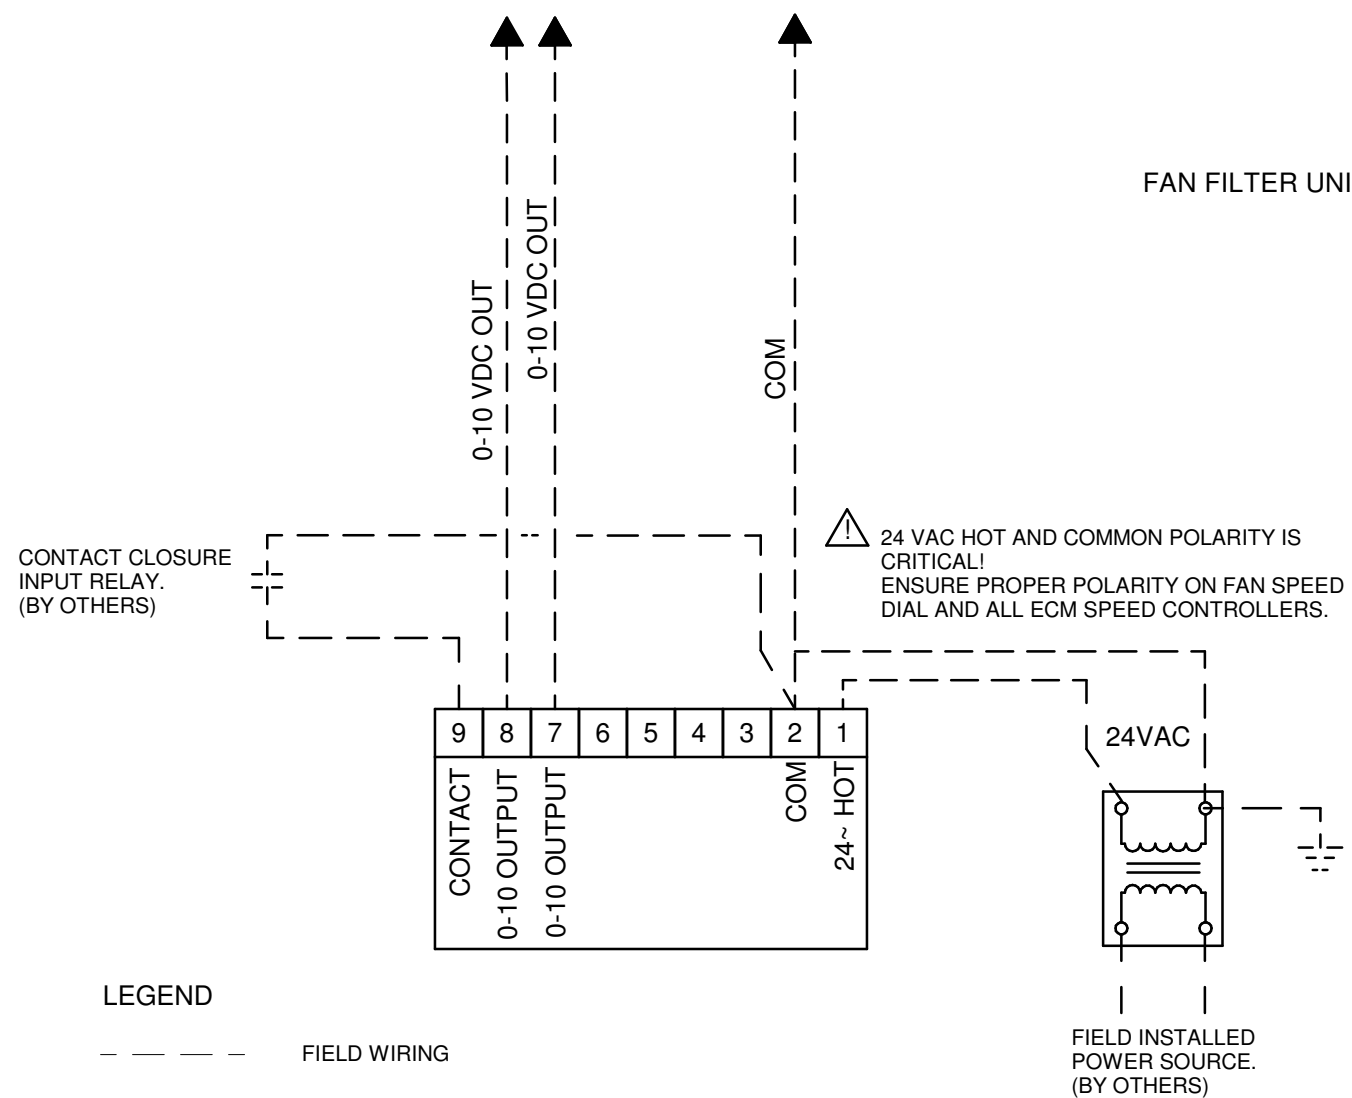


### LEGEND

--- FIELD WIRING

### FEATURES:

- WALL MOUNTED DIAL CONTROLS FAN SPEED FROM OFF (1.5 VOLTS) to 100% (10 VOLTS).
- EACH 0-10 VDC OUTPUT CONTROLS A MAX OF 15 DAISY CHAINED FAN FILTER UNITS (FOR A TOTAL OF 30 UNITS PER WALL MOUNTED SPEED CONTROLLER) WITH SAME SETPOINT.
- WORKS WITH ECMSC AND BFC CONTROLLERS.
- 0-10 VDC OUTPUT CONNECTS TO 'BAS SIGNAL' INPUT ON ECM SPEED CONTROLLER OR BFC CONTROLLER. USE A MAXIMUM OF 100 FEET FOR SIGNAL CABLES.
- 24 VDC POWER SUPPLY REQUIRED TO POWER WALL MOUNTED SPEED CONTROLLER.
- CONTACT CLOSURE: WHEN 'CONTACT' IS SHORTED TO 'COM' THE 0-10 VDC OUTPUTS WILL GO TO 0 VOLTS CAUSING ALL CONNECTED SPEED CONTROLLERS TO DEFAULT TO THEIR LOCAL SETTING.

FAN FILTER UNITS BEING CONTROLLED

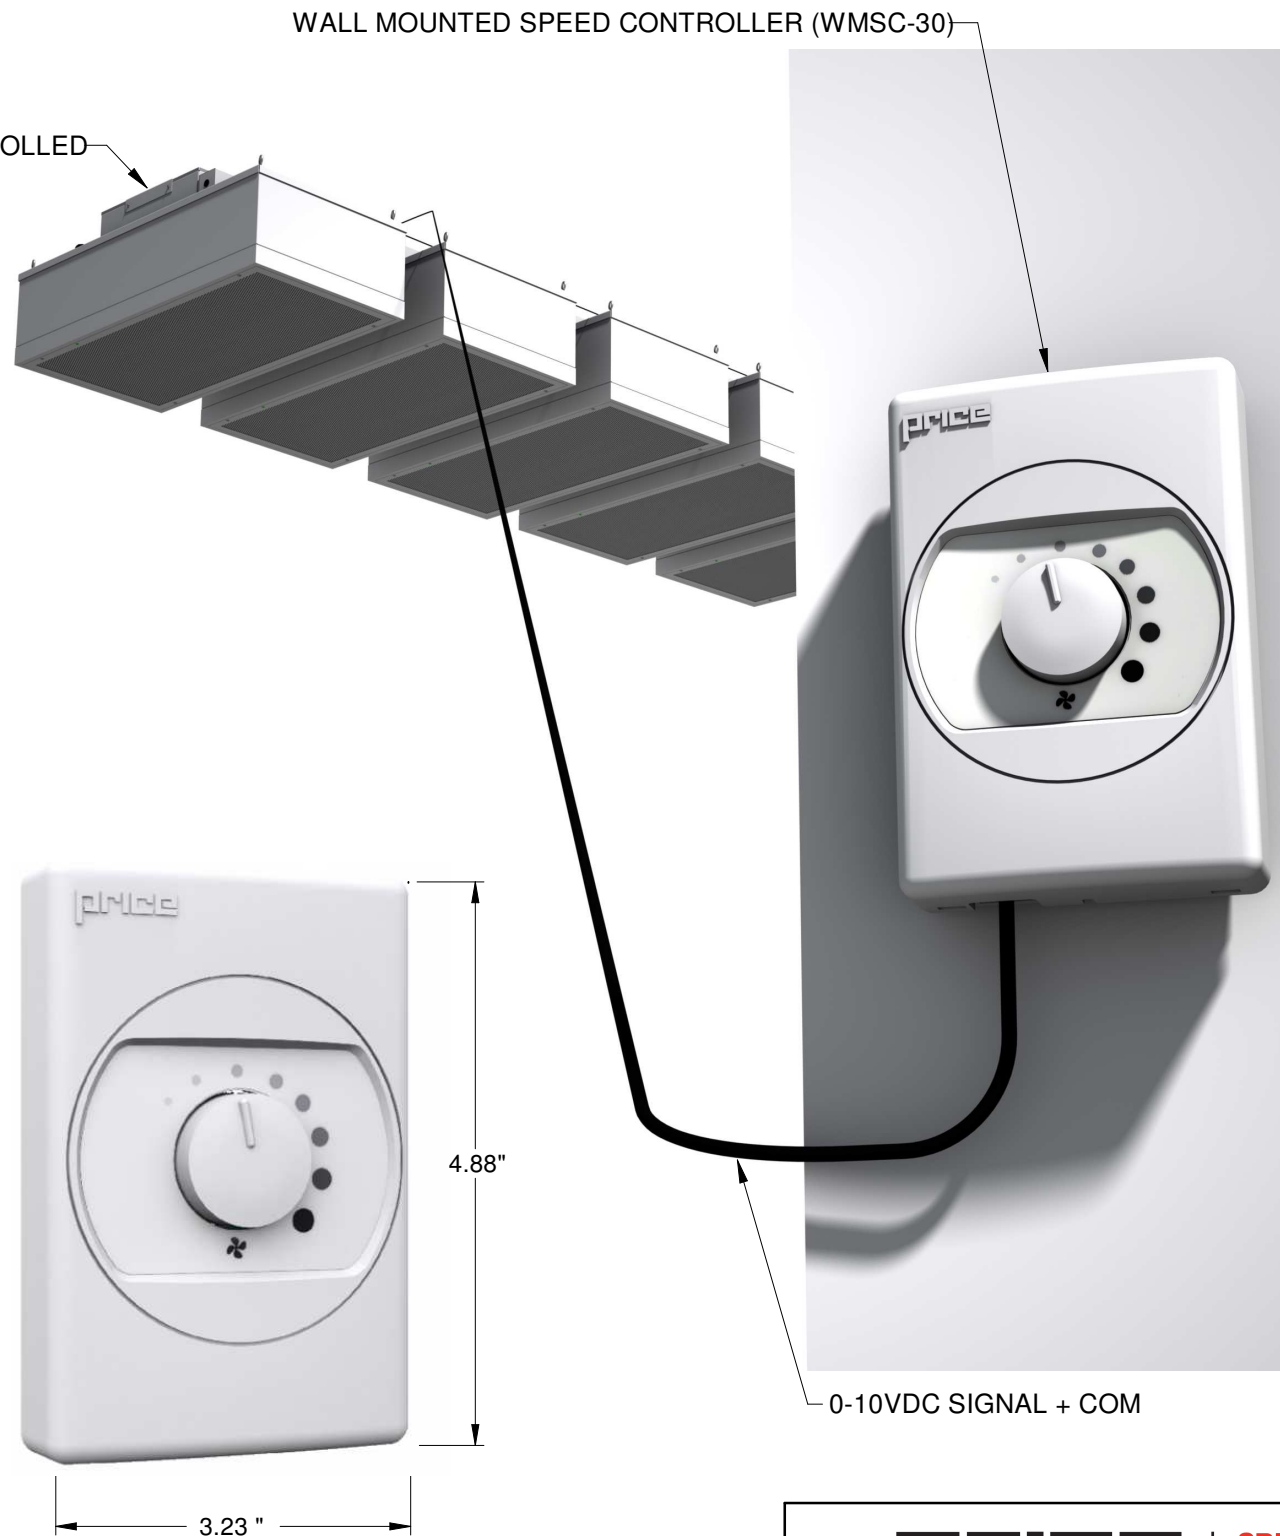

**PRICE** | **CRITICAL ENVIRONMENTS**

PROJECT:


273558

Revision: 0

08-09-2021



# FFUCS

## FAN FILTER UNIT CONTROL SYSTEMS BACNET FLOW CONTROLLER SERVICE TOOL (BFC-ST)

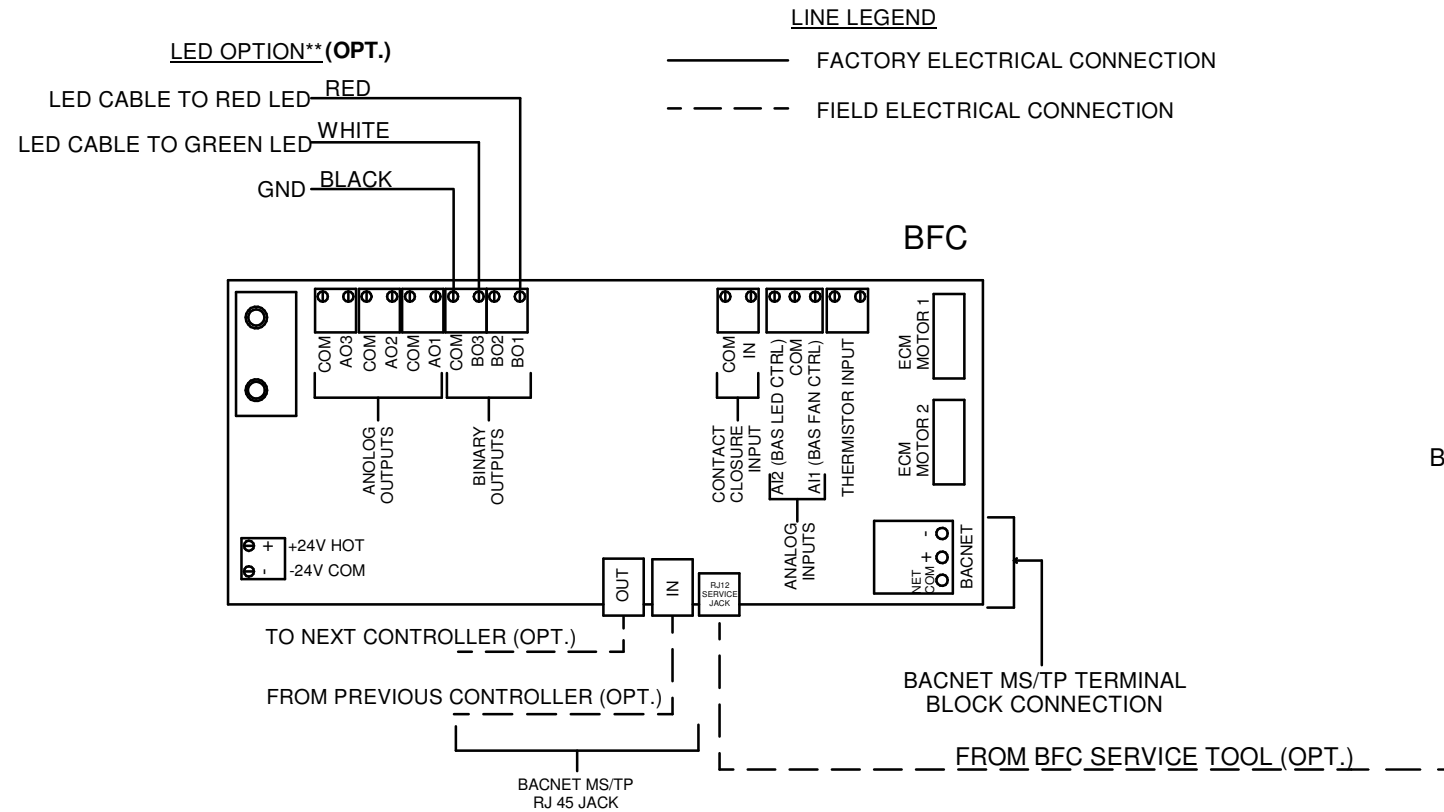

### FEATURES:

- SERVICE TOOL CONNECTS TO THE RJ12 PORT ON THE BFC BOARD FOR FULL CONTROL UP TO 6 FEET AWAY FROM THE CONTROL PANEL. CONTROLS AND MENUS ARE THE SAME ON THE BFC BOARD AND THE SERVICE TOOL.
- PROVIDES A MEANS TO CONTROL THE BFC BOARD WHEN THERE IS INSUFFICIENT CLEARANCE FOR TRADITIONAL CONTROL PANEL ACCESS OR FOR EASIER CONTROLS ACCESS.
- NO ADDITIONAL POWER SUPPLY IS REQUIRED TO POWER THE BFC SERVICE TOOL.

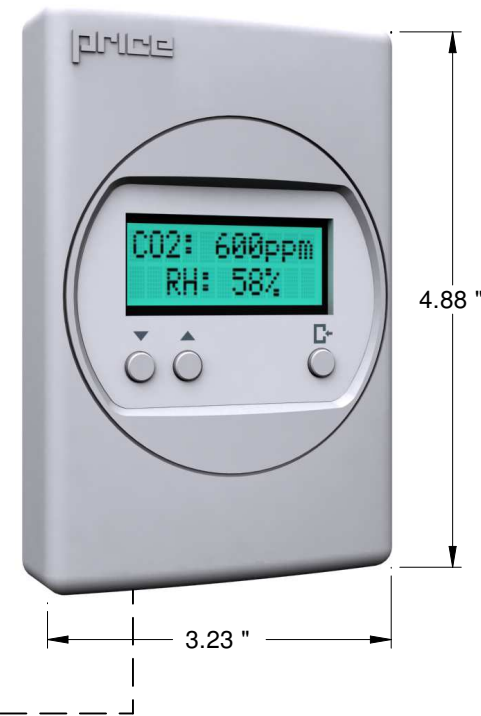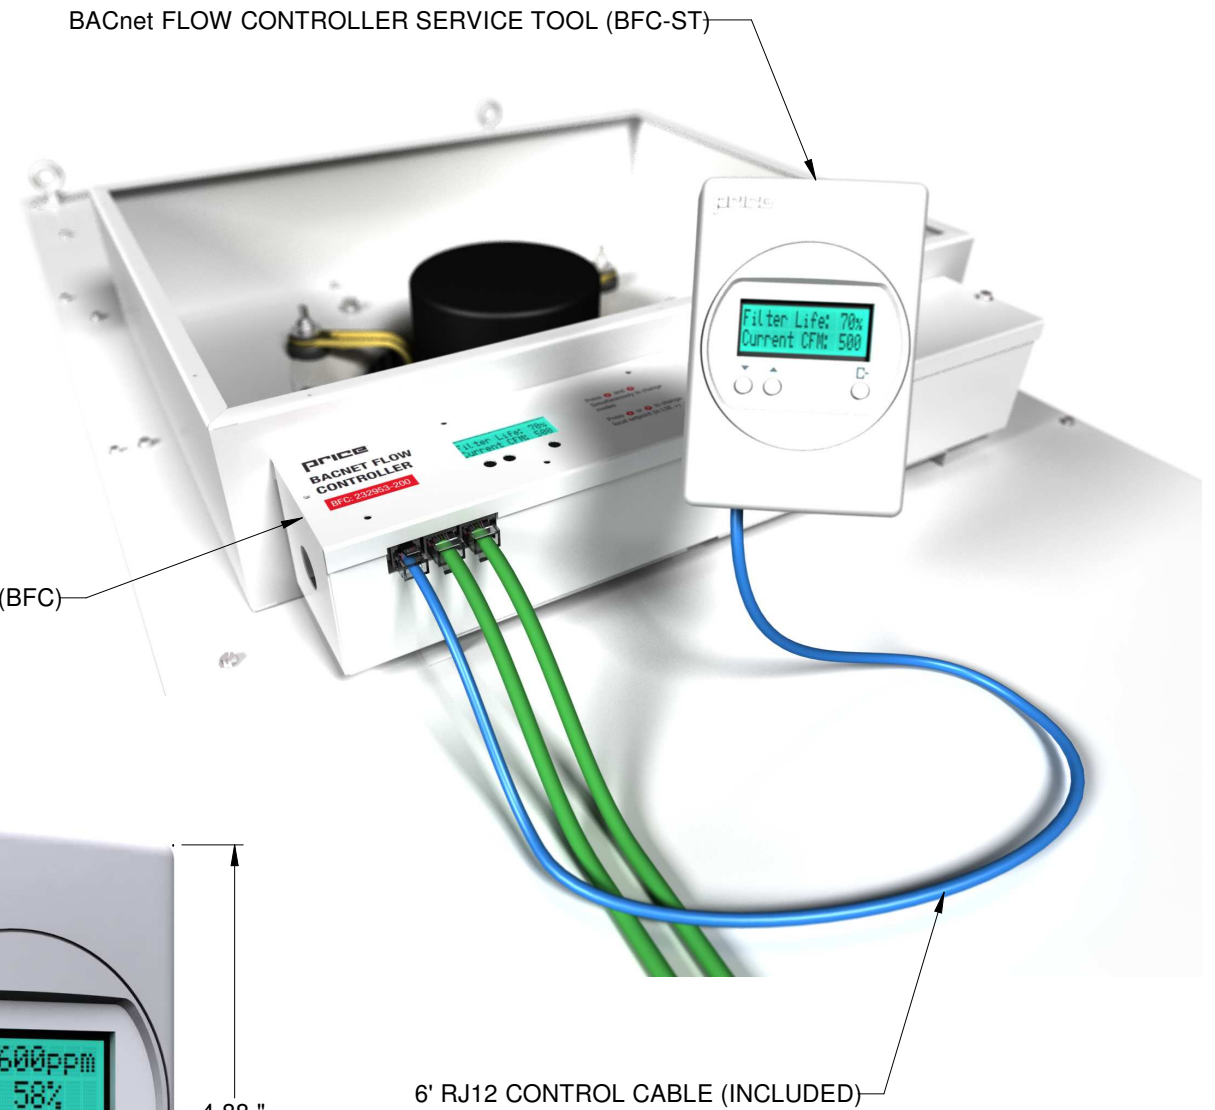

**PRICE** | **CRITICAL ENVIRONMENTS**

PROJECT:

273558

Revision: 0

08-09-2021

# FFUCS

## FAN FILTER UNIT CONTROL SYSTEMS BACNET WEB SERVER DEVICES


### WEB SERVER

#### FEATURES:

- INTERFACE TO BACnet MS/TP DEVICES IN BUILDING VIA WEB ADDRESS
- DISPLAY STATUS OF ETHERNET LAN VIA GREEN AND RED LEDs
- CAN BE CONFIGURED FOR REMOTE ACCESS VIA WEB ADDRESS
- ANIMATED GRAPHIC SCREENS (TO VIEW VARIABLES SUCH AS FILTER STATUS, CFM, FOR EACH FFU & MODIFY SET POINTS AS NEEDED)



### EXAMPLE WEB-BASED BACnet FFU CONTROL SYSTEM:

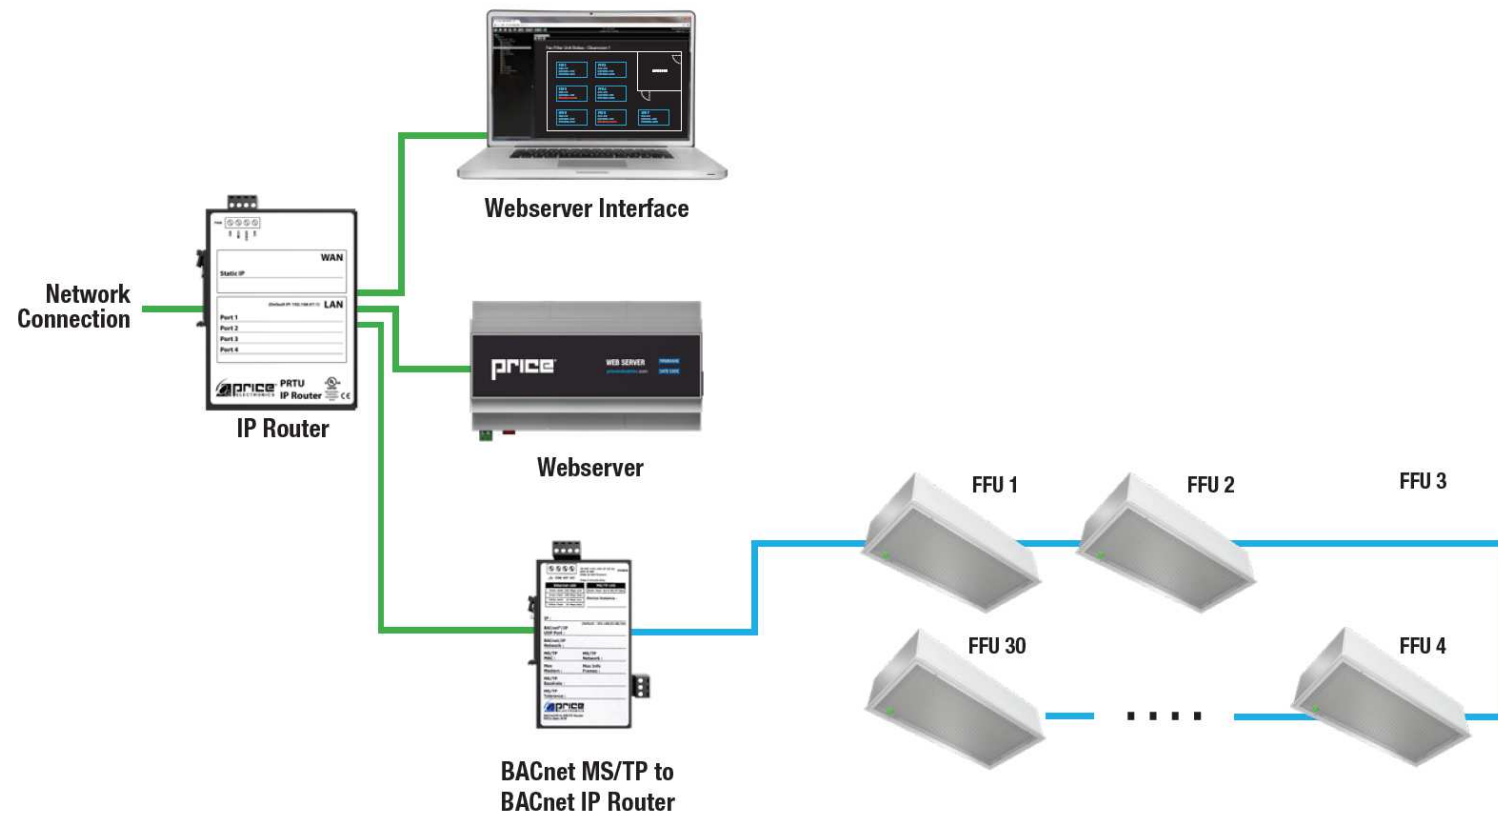

### EXAMPLE WEB SERVER GRAPHIC INTERFACE:

**BFC 24**

Unit Size: 24x48  
Unit Filter Type: RSR  
Unit Wheel Type: FC

Unit Fan Type: Constant Volume  
Unit Voltage Type: 115

**PRICE** | **CRITICAL ENVIRONMENTS**

PROJECT:

273558

Revision: 0

08-09-2021



# FFUCS

## FAN FILTER UNIT CONTROL SYSTEMS BACNET DEVICES



### BACnet ROUTER

#### FEATURES:

- CONNECTS BACnet IP/ETHERNET TO BACnet MS/TP SEGMENTS
- DISPLAYS STATUS OF POWER & ETHERNET VIA DIAGNOSTIC LEDs
- CAN BE CONFIGURED IN THE FIELD VIA WEB BROWSER



### IP ETHERNET ROUTER

#### FEATURES:

- CONNECTS BACnet TO BUILDING NETWORK
- DISPLAYS STATUS OF POWER, ETHERNET LAN & WAN VIA DIAGNOSTIC LEDs
- CAN BE CONFIGURED IN THE FIELD VIA WEB BROWSER
- STATEFUL FIREWALL, PAT, NAT & PORT FORWARDING PROPERTIES

### IP ETHERNET SWITCH

#### FEATURES:

- FIVE PORT UNMANAGED ETHERNET SWITCH PROVIDES 100 Mbps PERFORMANCE ON ALL PORTS
- ACCEPTS EITHER CROSS-OVER OR STRAIGHT THROUGH CABLES USING AUTO-DMIX PROTOCOL



- THE TABLE BELOW SHOWS THE NUMBER OF DEVICES REQUIRED FOR A GIVEN NUMBER OF FAN FILTER UNITS IN A SYSTEM.
- MORE UNITS CAN BE SUPPORTED, CONTACT CRITICAL ENVIRONMENTS APPLICATIONS TEAM FOR MORE INFORMATION.
- ASSUMES TWO PORTS ON IP ROUTER ARE FILLED WITH BACnet ROUTERS (i.e. 60 FFUs TOTAL).

#### EXAMPLE SYSTEMS:

Maximum # of Units	QTY of BACnet Routers	QTY of IP Switches	QTY of IP Router	Web Server
30	1	0	1	1
60	2	0	1	1
90	3	0	1	1
120	4	1	1	1
150	5	1	1	1
180	6	1	1	1
210	7	2	1	1
240	8	2	1	1
270	9	2	1	1
300	10	3	1	1
330	11	3	1	1

- SEE THE **BACnet FLOW CONTROLLER MANUAL** FOR MORE INFORMATION ON CONTROL SYSTEM OPTIONS.

**PRICE** | **CRITICAL ENVIRONMENTS**


PROJECT:

273558

Revision: 0


08-09-2021

**FFUCS**  
FAN FILTER UNIT CONTROL SYSTEMS  
SUPPORTING CONTENT

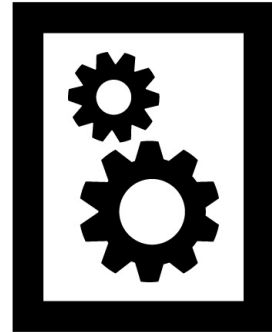


**MANUALS**

FFU/PURAFLO WIRING DIAGRAMS  
BACnet WIRING GUIDELINES FOR PRICE CONTROLS MANUAL  
BFC BACnet FLOW CONTROLLER MANUAL  
FFU/PURAFLO INSTALLATION MANUAL

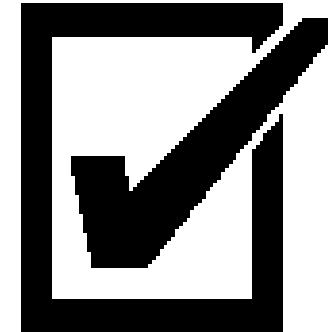

**SUBMITTALS**

FAN FILTER UNIT ROOM-SIDE REPLACEABLE FILTER SUBMITTAL  
FAN FILTER BENCH TOP REPLACEABLE FILTER SUBMITTAL  
ULTRA FAN FILTER UNIT WITH INTEGRATED LIGHTING SUBMITTAL

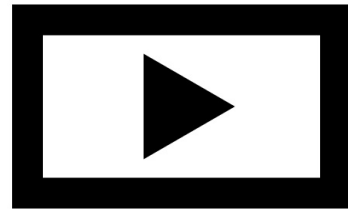

**VIDEOS**

FFU FAN FILTER UNIT CONTROL OPTIONS  
BACnet FLOW CONTROLLER START-UP GUIDE AND BASICS



**WEBSITE**

FOR MORE INFORMATION ON PRICE FAN FILTER UNITS, VISIT [PRICEINDUSTRIES.COM](http://PRICEINDUSTRIES.COM)



PROJECT:

273558

Revision: 0

08-09-2021