

Single Thermostat Operator Release (STO/R) **PRICE®** for Fire/Smoke Dampers & Motorized Multiblade Fire Dampers


STO/R Package - Single Thermostat Operator Release

In today's life safety products markets, many building codes require fire dampers, smoke dampers and combination fire and smoke dampers to be inspected for proper operation. Many of these codes require that the damper be inspected and cycled every 6 months to a year depending on the local authority and the type of system in which it is installed. Usually fire dampers and combination fire and smoke dampers are supplied with a fusible link. The fusible link is a one time device and is generally limited to 165°F or 212°F. Once the link has experienced these elevated temperatures, it can no longer be used and must be replaced with an identical link. Locating and acquiring

the identical fusible link can be troublesome and time consuming. PRICE's STO/R option provides the ease of operating and resetting the damper in a matter of seconds without replacing the link. The is used in lieu of a conventional fusible link. It is a reusable/ resettable heat responsive device that can only be reset after a visual inspection of the damper. **Dampers which allow remote resetting of the damper from a remote location are dangerous.** A remotely reset damper may not be fully functional and should be visually inspected. The STO/R is reset from the outside of the damper sleeve, therefore requiring a visual inspection of the damper. By depressing a button on the

outside of the sleeve an inspector can verify if the damper is fully operational. The STO/R is a multi-use heat responsive device. It is wired in series with the smoke detector therefore it is user friendly in most applications. When the smoke detector interrupts the current to the damper, the STO/R will not hinder the closing of the damper. The STO/R package includes blade indicator switches which allow for remote notification of damper blade position, as a standard feature.

The STO/R option is available on all PRICE Model FSD Combination Fire/Smoke Dampers and Motorized Multi-Blade Fire Dampers.

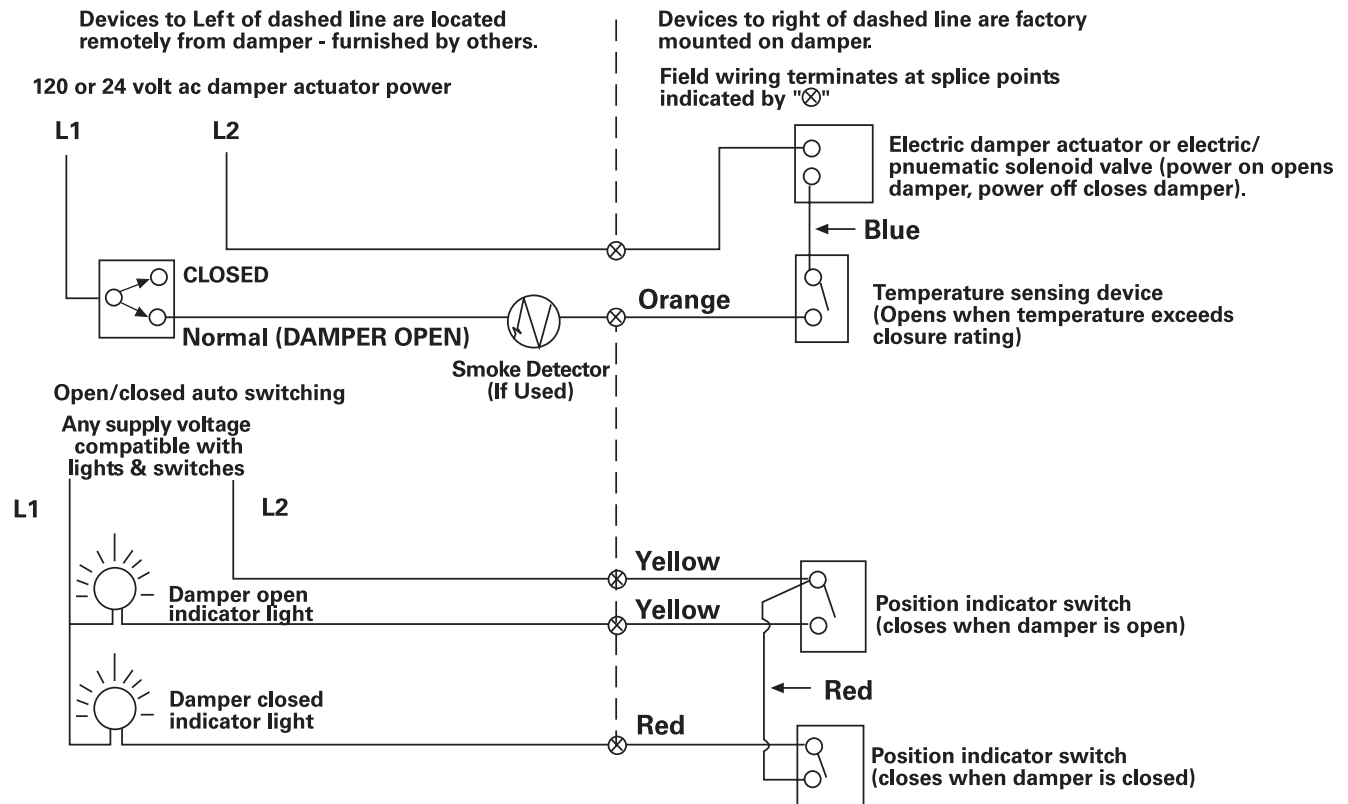

FSD DAMPER STO/R OPERATION

Switch is in Normal (Damper Open) Position: Damper motor is energized until thermostat senses temperature above initial closure rating. Above temperature closure rating, the damper motor is de-energized and damper closes.

Smoke Detector (if used) wired in series with temperature sensitive device.

Switch in Closed Position damper motor is de-energized and damper is closed.

Detailed wiring diagrams including terminal designation and/or wire color coding furnished with each shipment.

Indicator Switch Electrical Limitations

Installation:

- 10 Amperes, 1/4 HP, 120 or 240 Volts A.C.
- .5 Ampere, 125 Volts D.C.
- .25 Ampere, 250 Volts D.C.
- 5 Amperes, 120 Volts (Lamp Load)
- 15 Amperes, 24 Volts D.C.


Manufacturer's Recommendations

All moving parts of the damper must be inspected and cycled at intervals not greater than every six months and in accordance with the latest edition of NFPA 90A, 92A, local codes and the actuator manufacturer. In addition, fuse links shall be removed and inspected for corrosion. Dry lubricants are recommended.


Single Thermostat Operator Release (STO/R) **for Fire/Smoke Dampers &** **Motorized Multiblade Fire Dampers**

STO/R Package - Single Thermostat Operator Release

STO/R Wiring Details

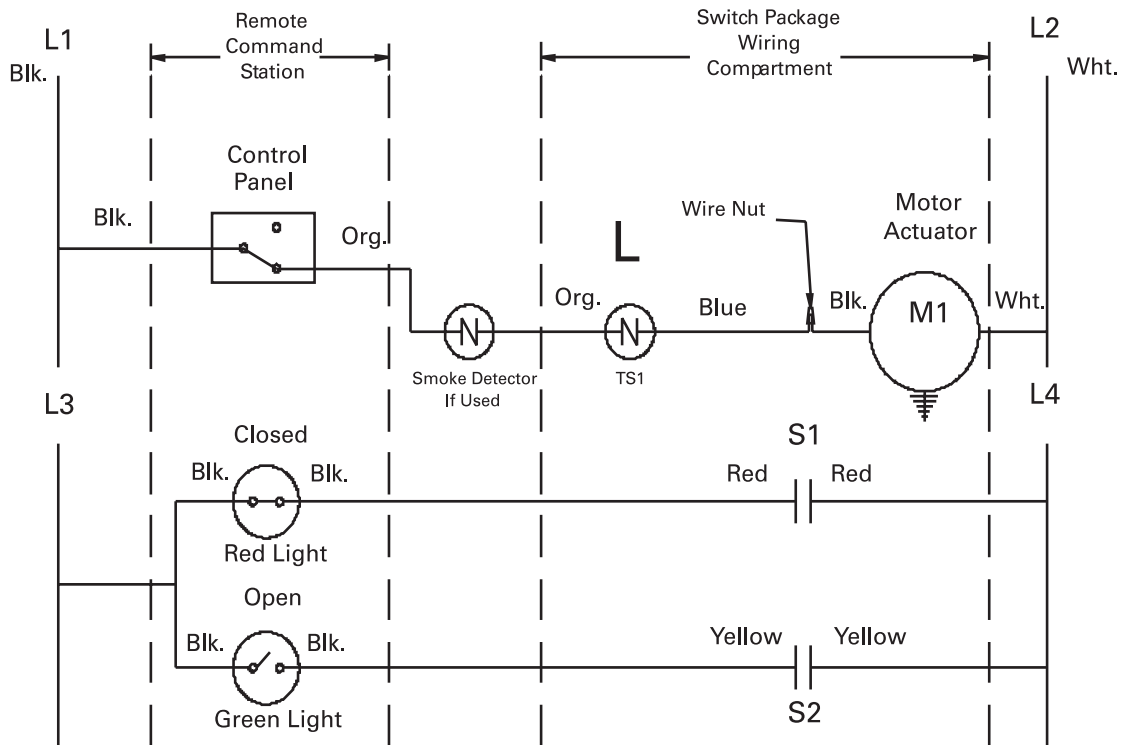


L3, L4 is a Supply Voltage Compatible with Lights and Switches. Standard Voltage is Same as Actuator Ordered.

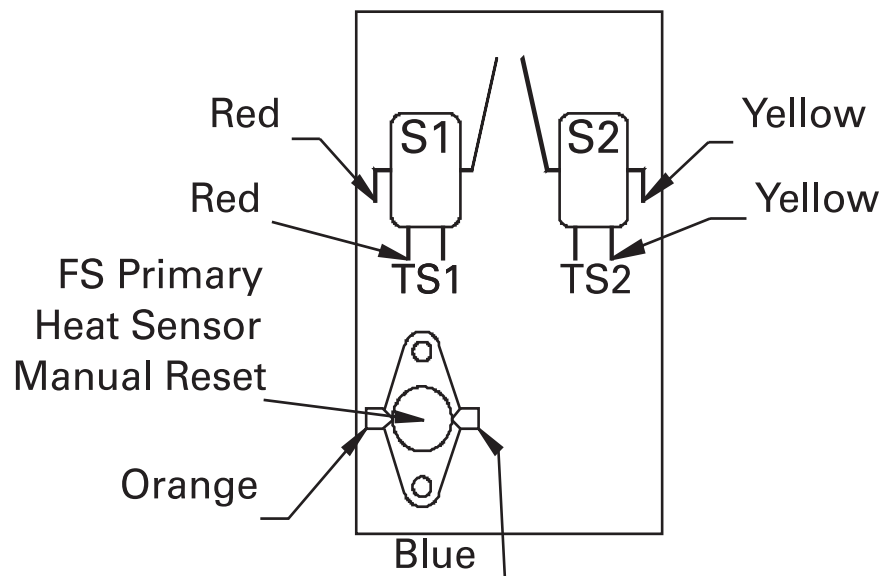


Single Thermostat Operator Release (STO/R) **for Fire/Smoke Dampers & Motorized Multiblade Fire Dampers**

STO/R Package - Single Thermostat Operator Release

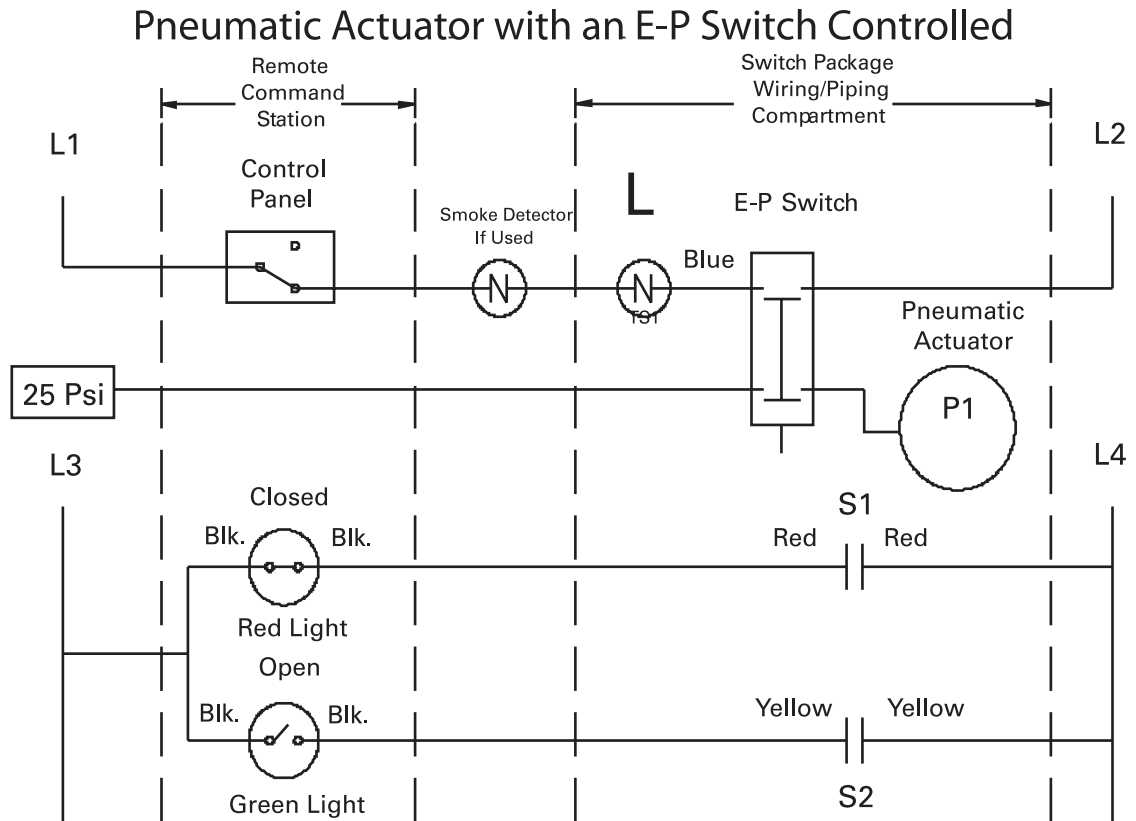


L1, L2 is the E-P Switch Supply Voltage desired (120vac or 24vac). L3, L4 is a Supply Voltage Compatible with Lights and Switches. Standard Voltage is 120vac if not Specified.

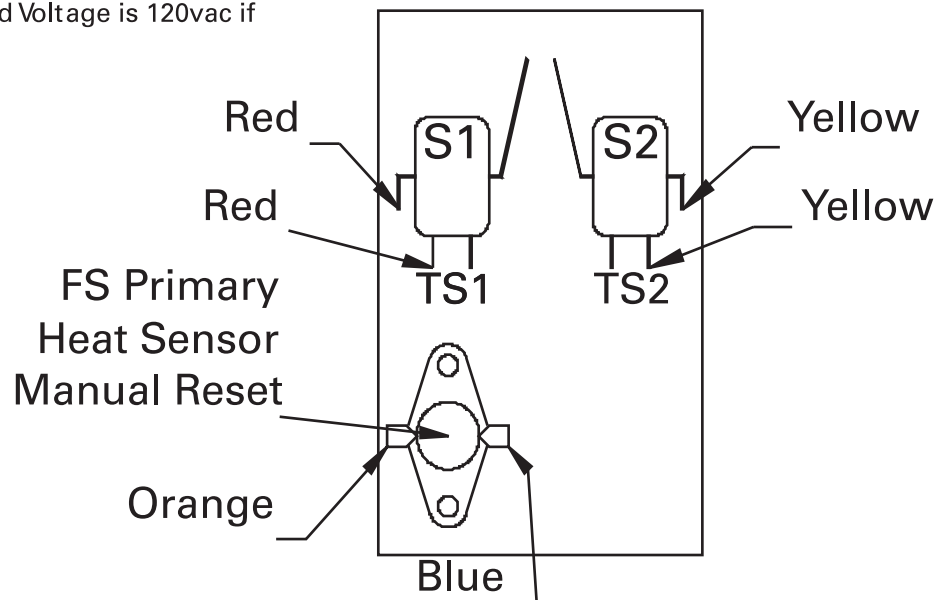

Single Thermostat Operator Release (STO/R) **for Fire/Smoke Dampers & Motorized Multiblade Fire Dampers**

STO/R Package - Single Thermostat Operator Release

Pneumatic Actuator with a PFV Option

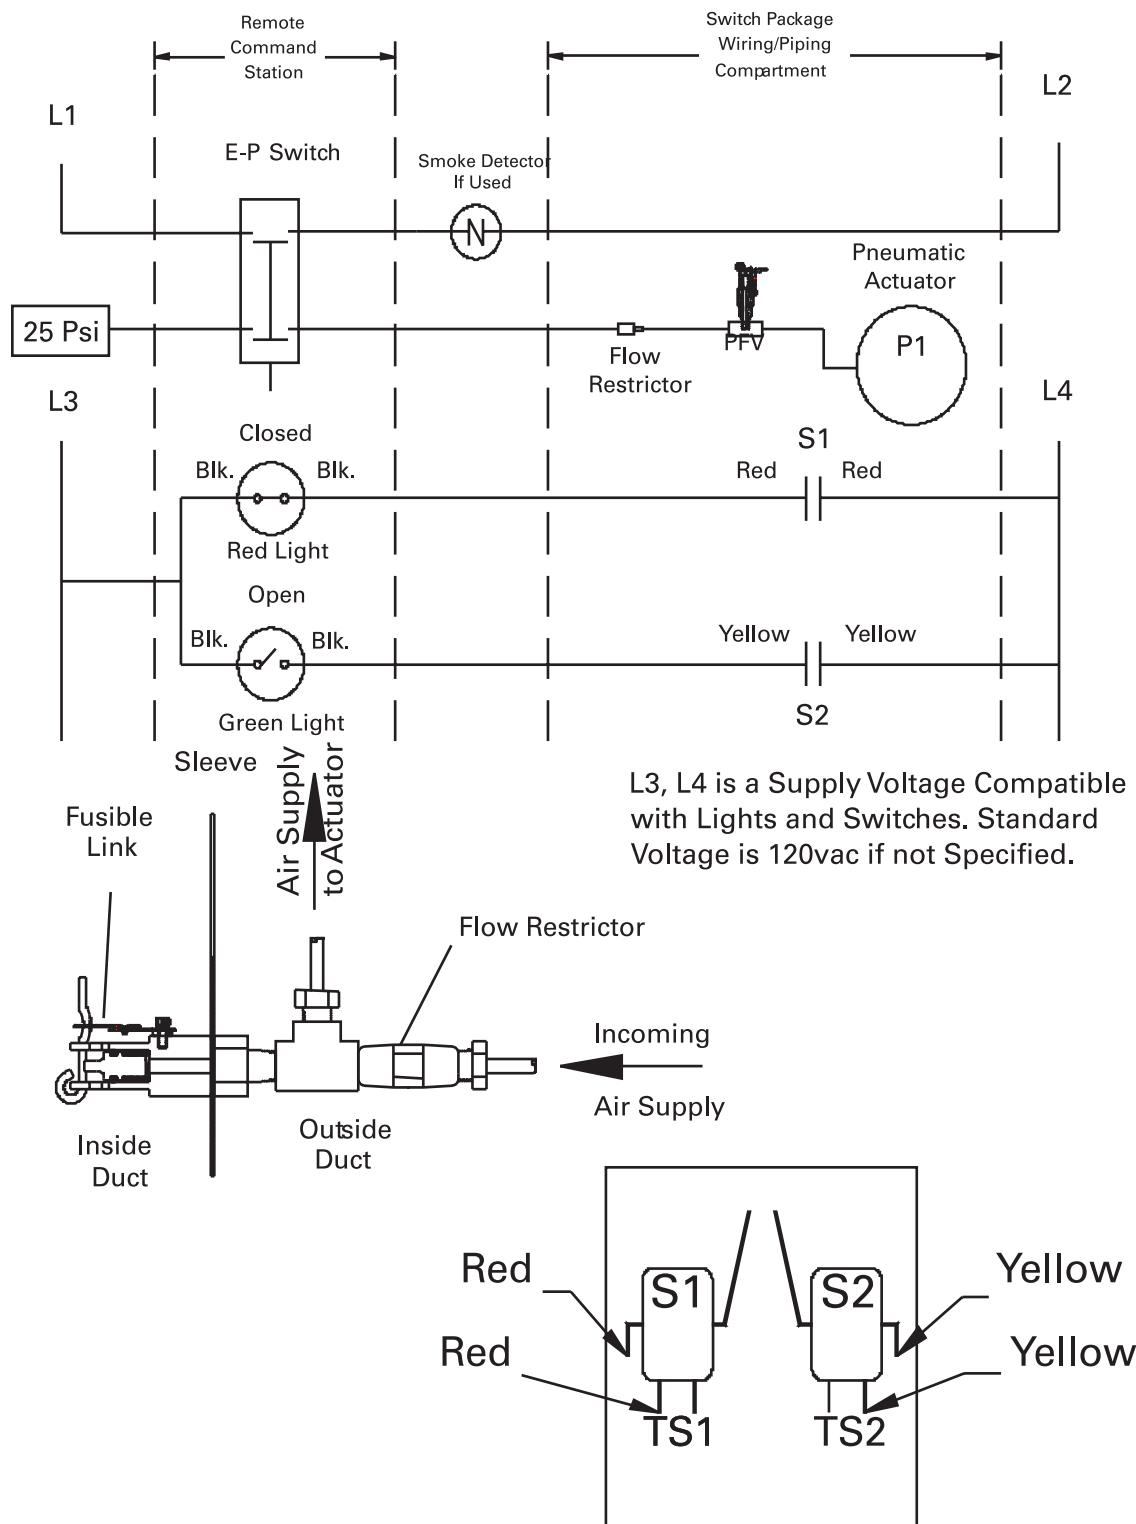

L3, L4 is a Supply Voltage Compatible with Lights and Switches. Standard Voltage is 120vac if not Specified.