




TYPICAL INSTALLATION DETAILS VCS4

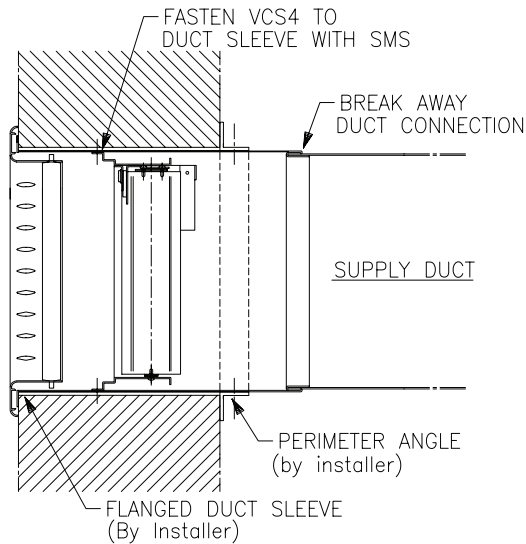

☐ **SIDE WALL INSTALLATION**

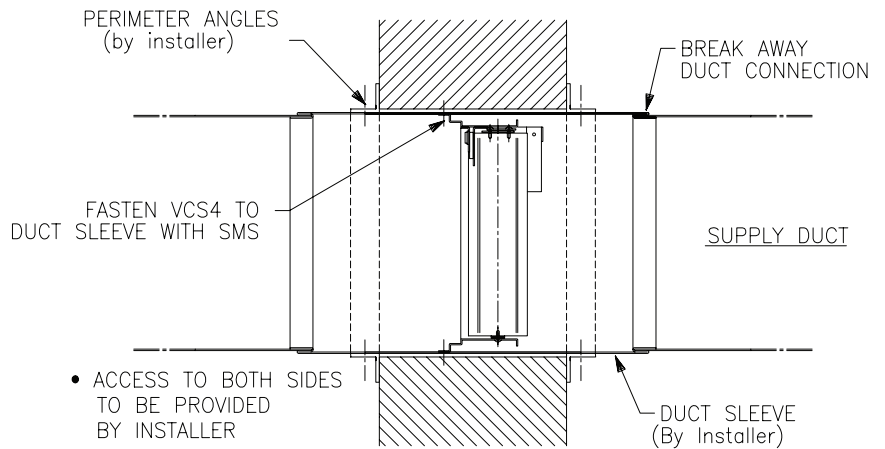

☐ **WALL INSTALLATION**

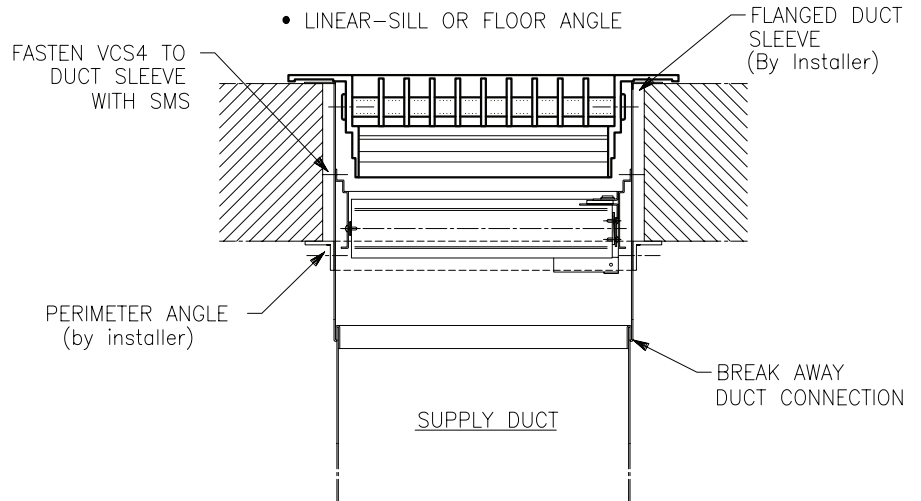


☐ **FLOOR INSTALLATION**

NOTES:

- DUCT SLEEVE IS TO BE THE SAME GAUGE OR HEAVIER AS THE DUCT TO WHICH IT IS ATTACHED. IN NO CASE SHALL DUCT SLEEVE BE LIGHTER THAN 18 GAUGE. METAL GAUGES SHALL CONFORM TO SMACNA OR ASHRAE DUCT STANDARD.
- DAMPER SHALL BE FASTENED TO DUCT SLEEVE WITH #10 SHEET METAL SCREWS SPACED 6" ON CENTERS MAXIMUM.
- PERIMETER ANGLES SHALL BE MINIMUM OF 1½" X 1½" X 16 GAUGE. FASTEN TO DUCT SLEEVE WITH #10 SHEET METAL SCREWS SPACED 6" ON CENTERS.

ALL METRIC DIMENSIONS () ARE SOFT CONVERTED. IMPERIAL DIMENSIONS ARE CONVERTED TO METRIC AND ROUNDED TO THE NEAREST MILLIMETER.

PROJECT:			
ENGINEER:			VCS4 FIRE DAMPER TYPICAL INSTALLATION DETAILS
CUSTOMER:		222073	
SUBMITTAL DATE:	SPEC. SYMBOL:	MAY 93	